

Project Team

SAMPLE ONLY

COPYRIGHT BY
CREATIVE CONCEPTS AND DESIGN, INC.



EXIT INFORMATION	
MERCANTILE	14,074 S.F. / 30 = 500 PERSONS
RECEIVING	1,209 S.F. / 300 = 5 PERSONS
OFFICE, TOILETS, CORR.	820 S.F. / 100 = 9 PERSONS
MEZZANINE	1,868 S.F. / 60 = 32 PERSONS
TOTAL	18,868 S.F. 546 PERSONS

2 EXITS REQUIRED PER TABLE 1019.1
546 X .15' = 81.90' INCHES WIDTH REQUIRED
TOTAL EXIT WIDTH PROVIDED - 60' + 35' + 35' = 130'
MAXIMUM TRAVEL DISTANCE 250 FEET (SPRINKLED)

TWO EXITS REQUIRED (GREATER THAN 50 OCCUPANTS)
DIAGONAL DISTANCE AREA BEING SERVED = 158 FEET
187' / 2 = 93.5'
153.83' BETWEEN EXIT ACCESS DOORS (GREATER THAN) 93.5'

FP	= FIRE PULL
FS	= FIRE STROBE
⊕	= FIRE EXTINGUISHER LOCATION
⊙	= SURFACE MTD. SMOKE DETECTOR

PLAN NOTES
1. ADD TACTILE SIGNS COMPLYING WITH ICC A117.1 CH. 7 - SHALL BE PLACED AS INDICATED ON PLAN. SEE 2/A0.3 (MIN. 48" AND MAX. 60" A.T.F. PER A117.1 703.3.11)
2. VERIFY EXISTING THRESHOLD ELEVATION CHANGES CONFORM TO MAX. 1/4" VERTICAL OR 1/2" AND BEVELED PER NFPA 7.1.6.2 AND ANSI 117.1.

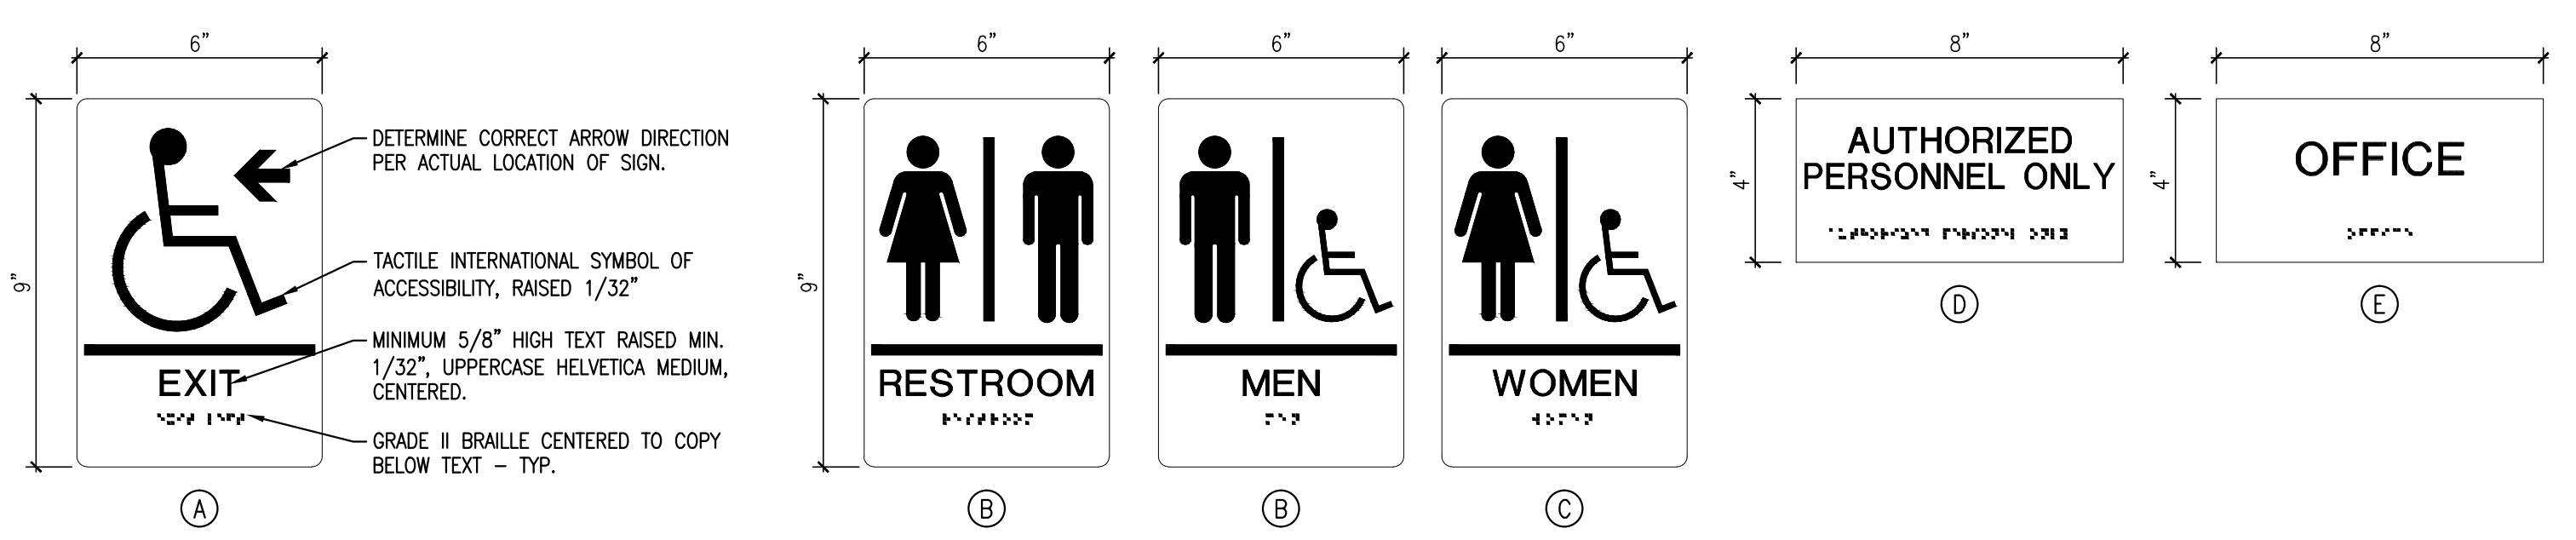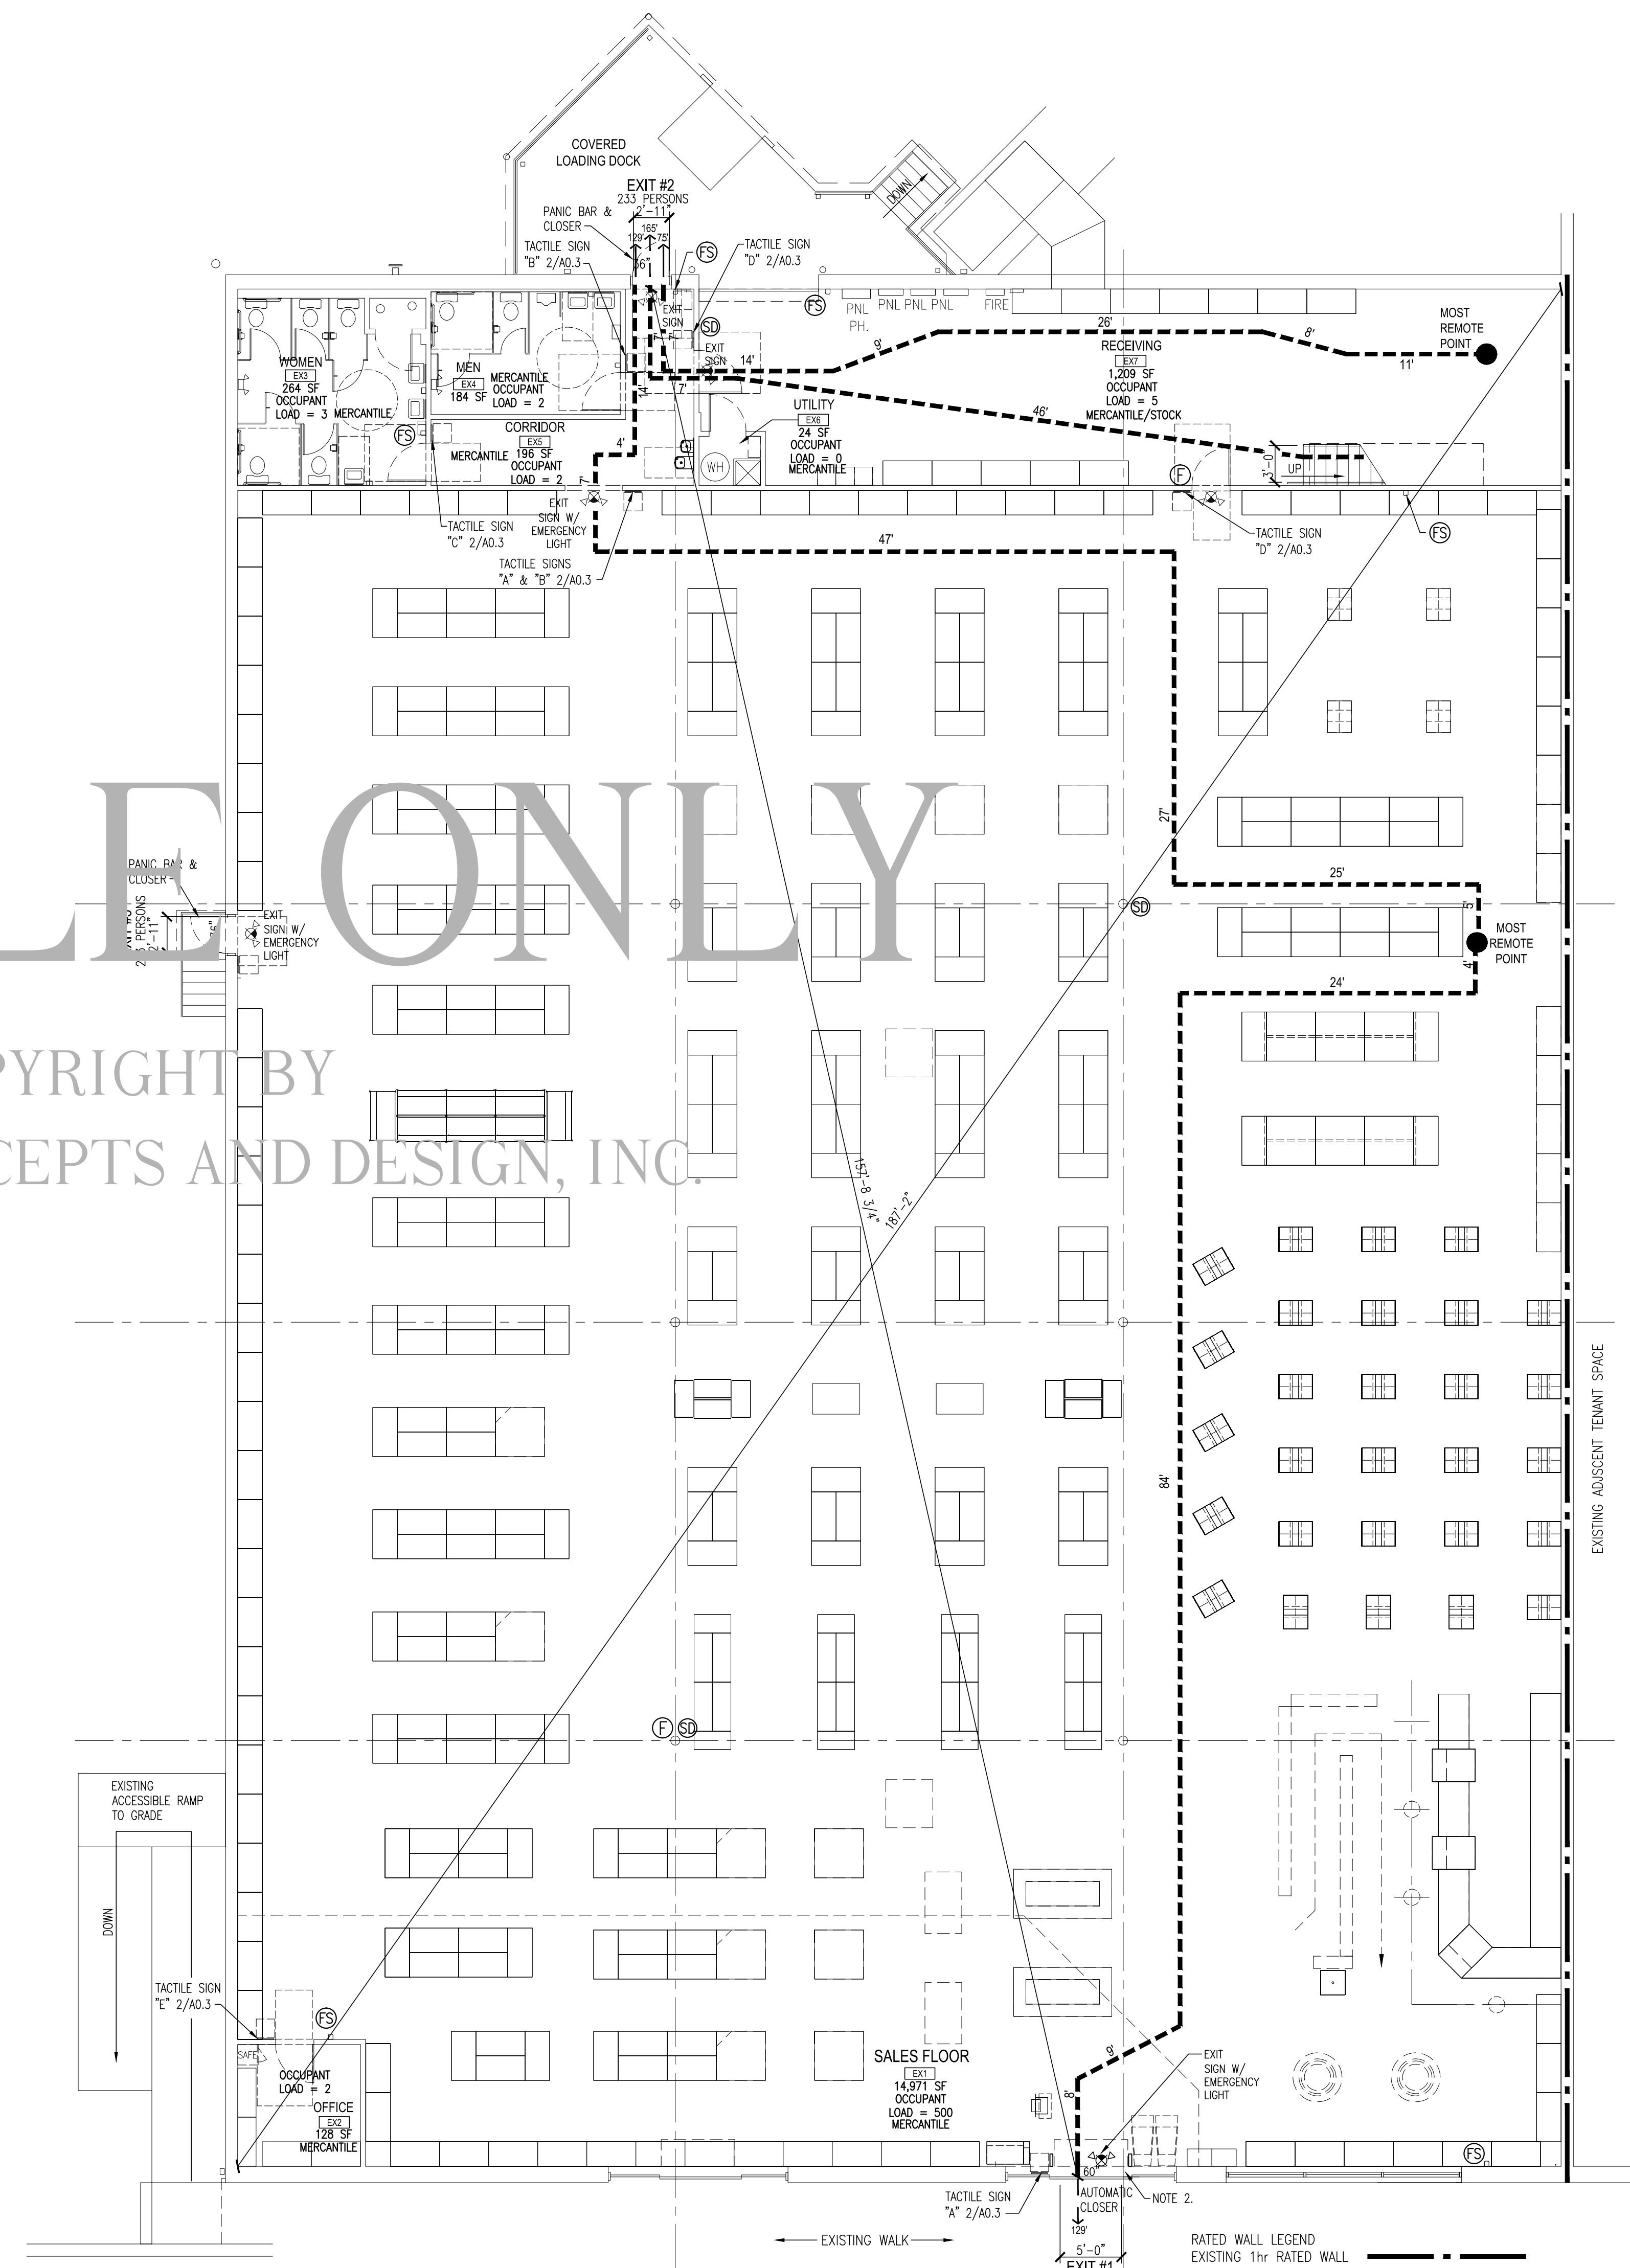

NOTES:
1. ALL TACTILE SIGNAGE TO CONFORM TO THE CURRENT ANSI 117.1 ACCESSIBLE AND ALL LOCAL CODES.
2. PLACE TACTILE SIGNAGE ON WALL ADJACENT TO THE LATCH SIDE OF THE DOOR OR ON THE RIGHT SIDE OF CASED OPENING AND RIGHT SIDE OF A PAIR OF DOORS.
3. MOUNTING HEIGHT SHALL BE 60" ABOVE FINISH FLOOR TO THE CENTERLINE OF THE SIGN.
4. SEE FLOOR PLAN FOR GUIDE TO SIGN LOCATIONS.

2 Accessible Signage
A.0.3 SCALE: 3" = 1'-0"

1 Life Safety Plan
A.0.3 SCALE: 1/8" = 1'-0"

Project:

Seal

Issue Date: 6/6/2014

Revisions :

Sheet Title:
LIFE SAFETY PLAN

A-0.3
Sheet no.